
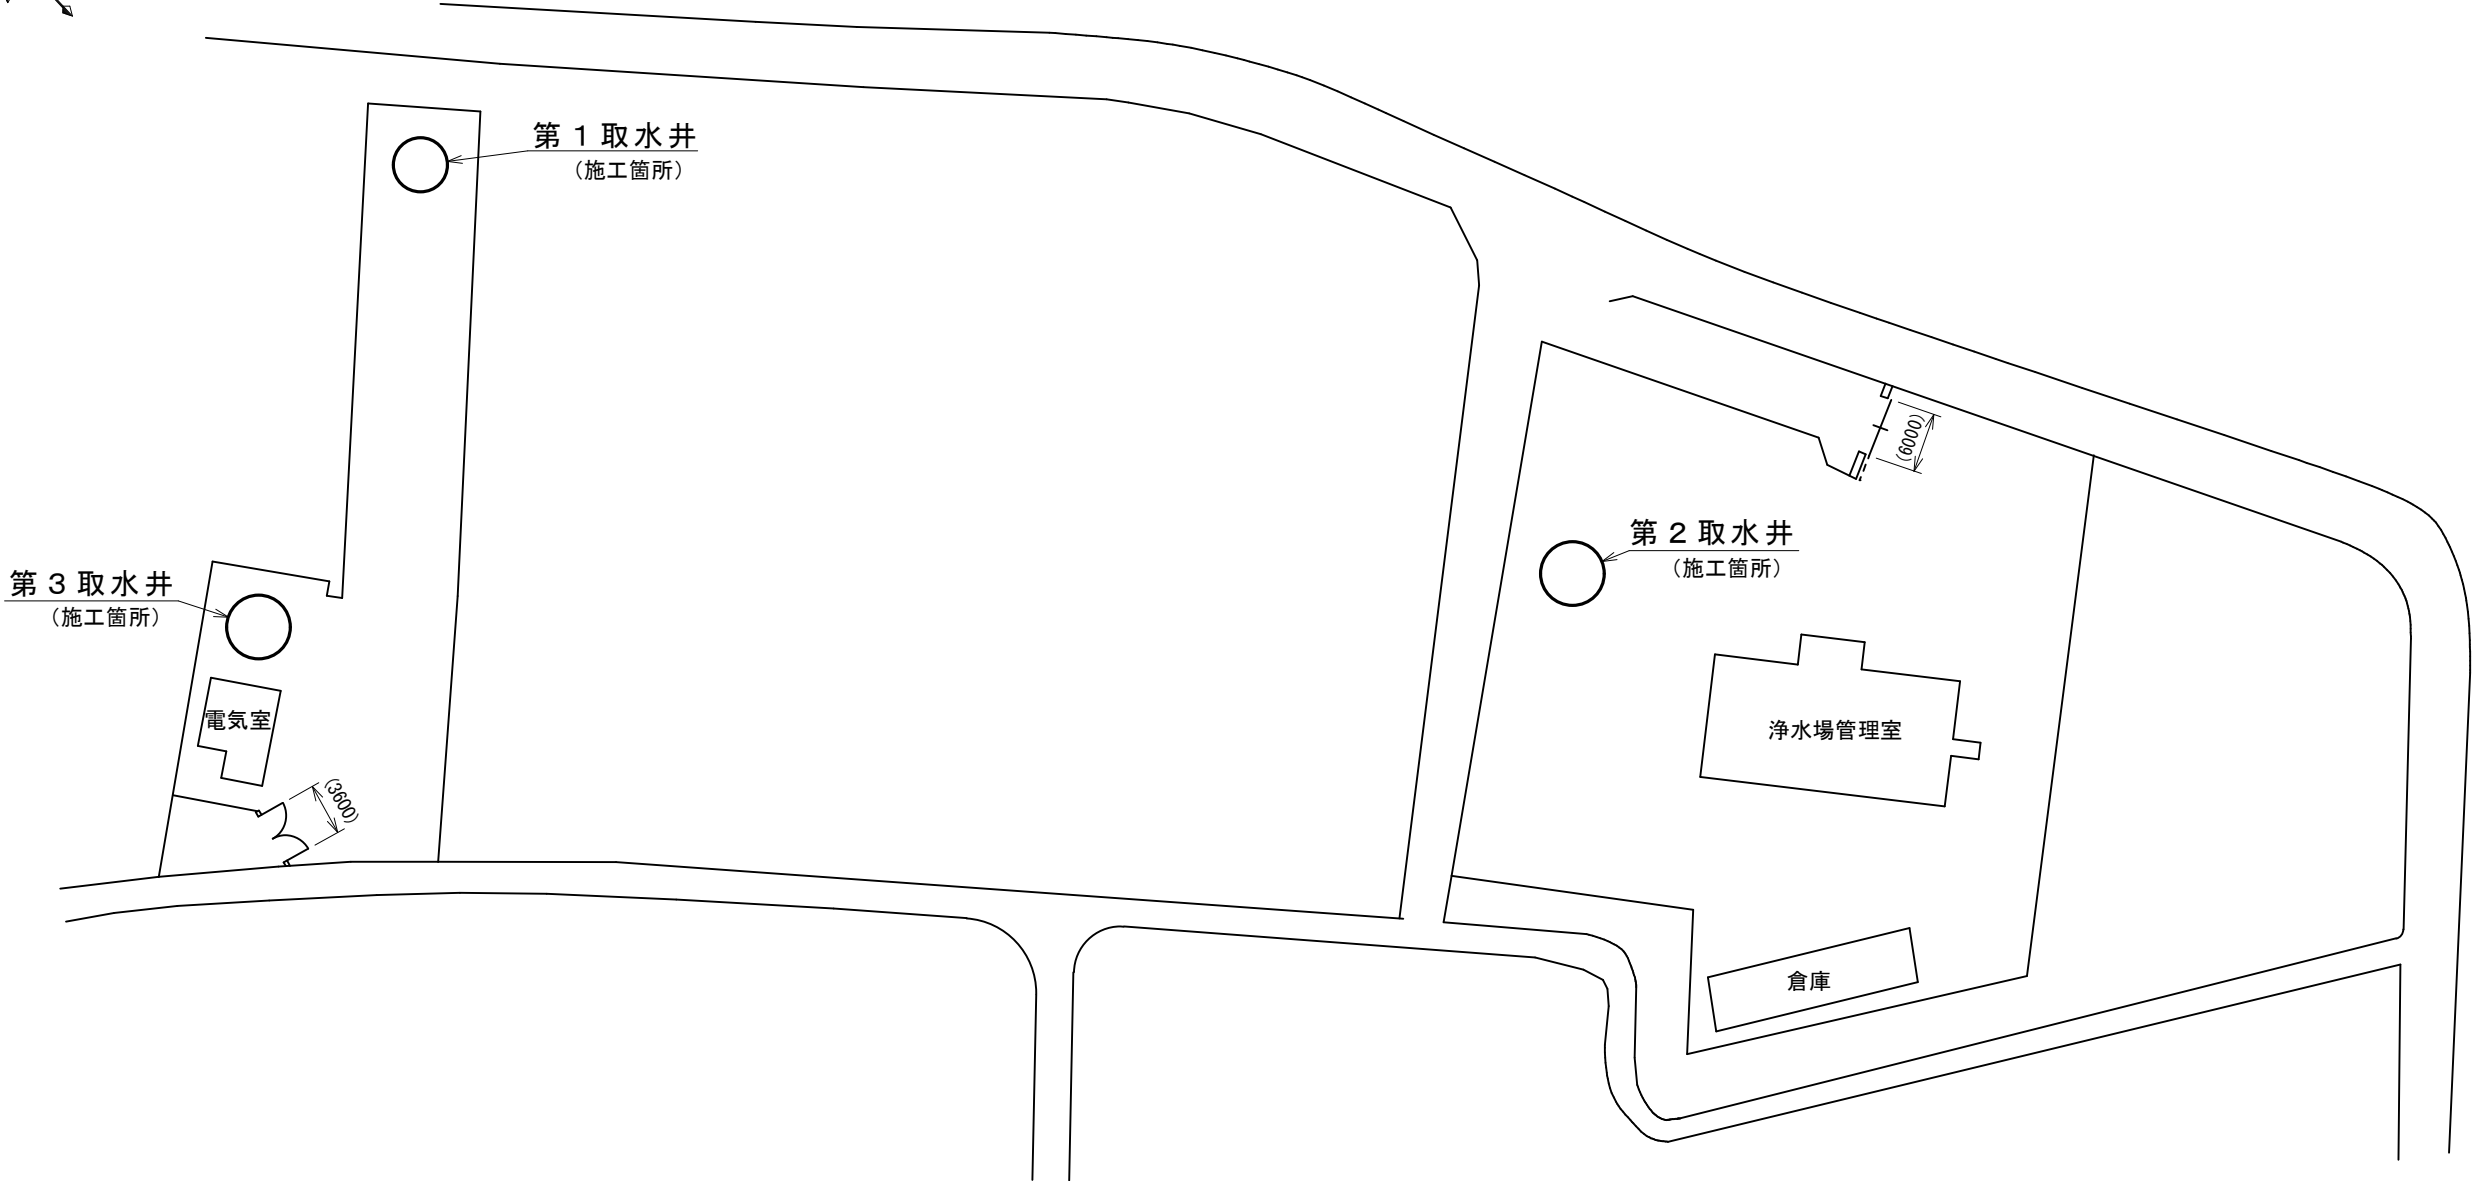



芸濃北神山浄水場 配置図



※本図は参考図であり施工現場と本図に相違がある場合にあっては
相違箇所を再調査後、市監督員と協議のうえ詳細を決定すること。

工 事 名	令和6年度水施第4号 芸濃北神山浄水場取水ポンプ更新工事		
施工場所	津市 芸濃町北神山 地内		
図 名	芸濃北神山浄水場 配置図		
縮 尺	—	図面番号	1/5
津市上下水道事業局			

第 1 取水井取水ポンプ据付図

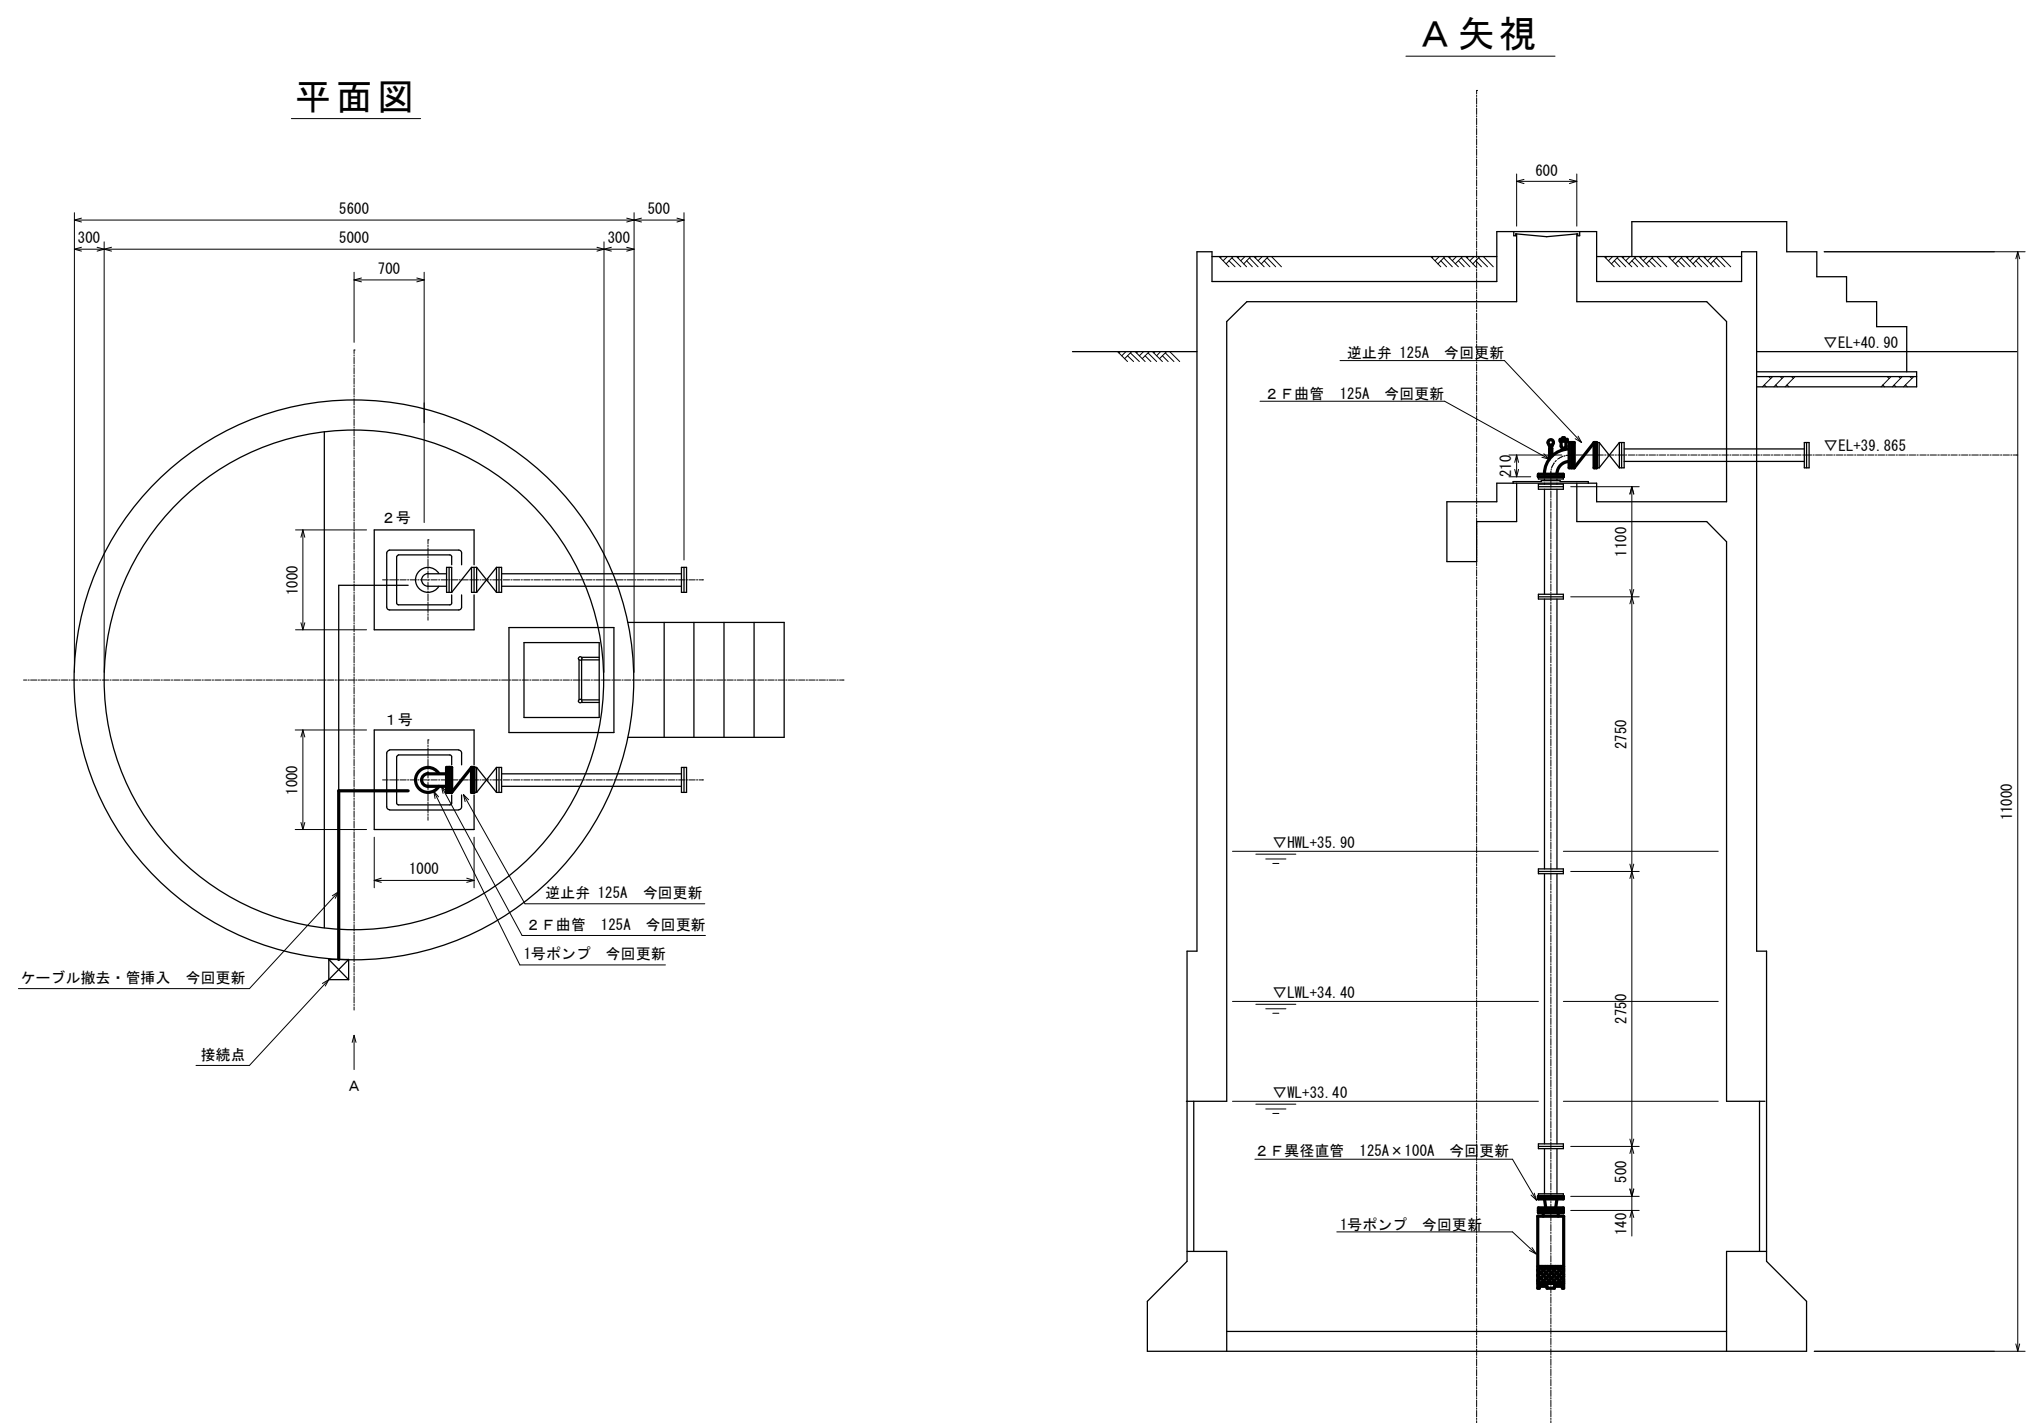


原図：A 3

※本図は参考図であり施工現場と本図に相違がある場合にあっては相違箇所を再調査後、市監督員と協議のうえ詳細を決定すること。


工 事 名	令和 6 年度水施第 4 号 芸濃北神山浄水場取水ポンプ更新工事		
施工場所	津市 芸濃町北神山 地内		
図 名	第 1 取水井取水ポンプ据付図		
縮 尺	1/75	図面番号	2/5
津市上下水道事業局			

第 2 取水井取水ポンプ据付図

平面図

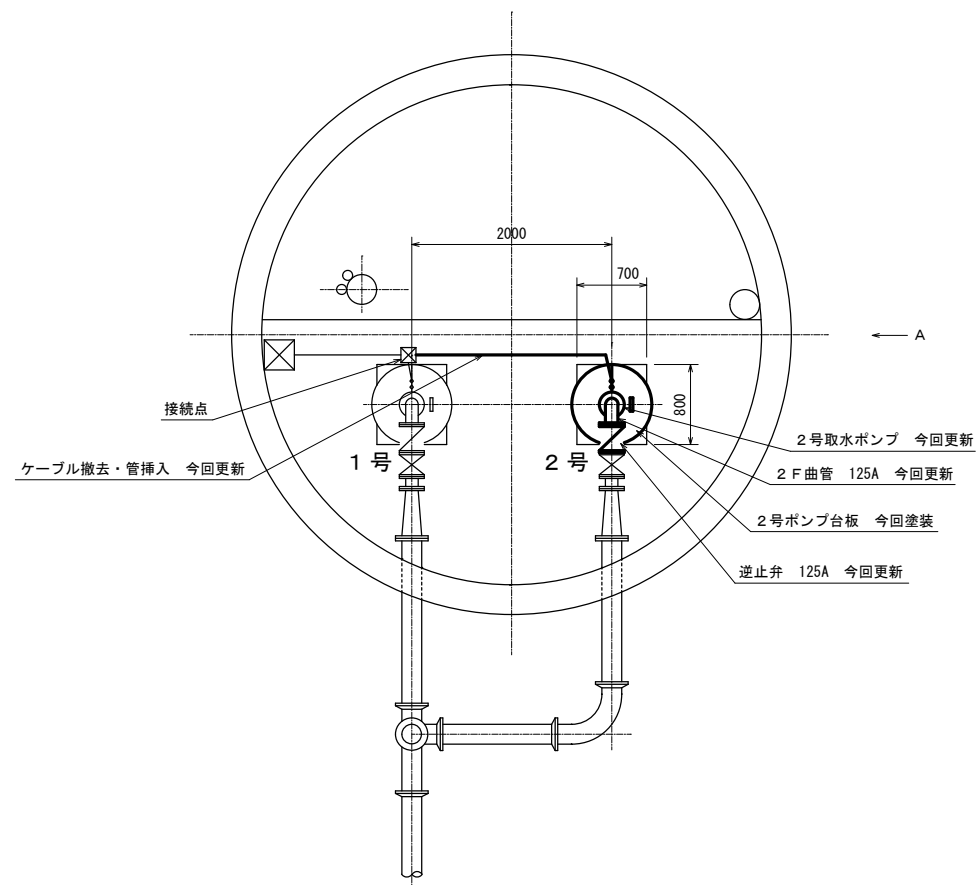

A 矢視

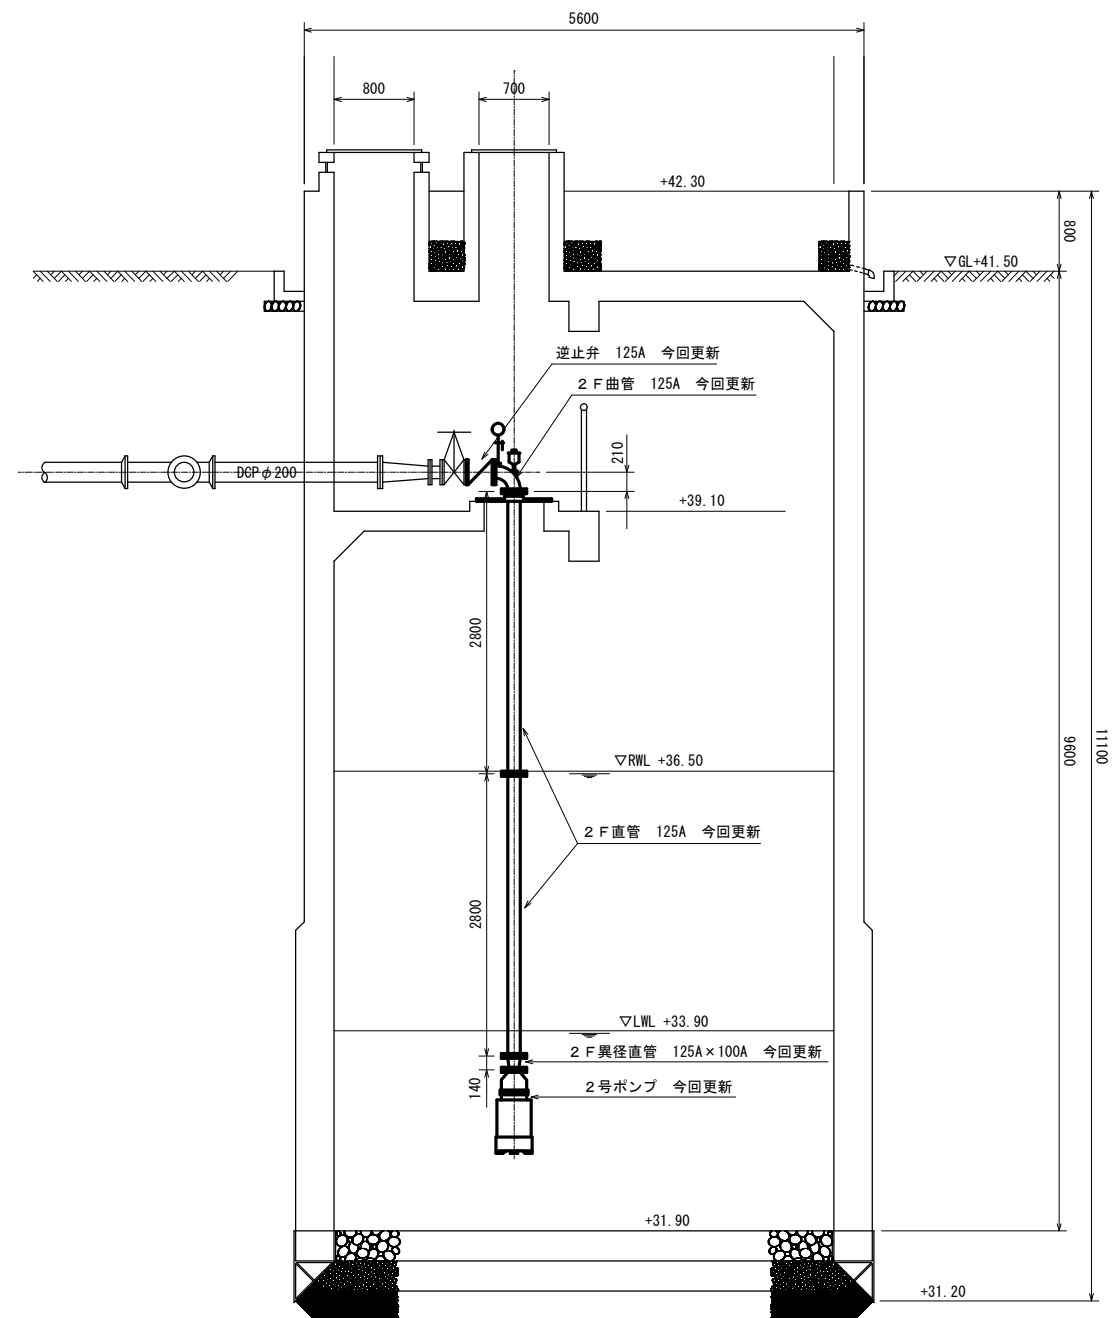

原図 : A 3

※本図は参考図であり施工現場と本図に相違がある場合にあっては相違箇所を再調査後、市監督員と協議のうえ詳細を決定すること。

工 事 名	令和 6 年度水施第 4 号 芸濃北神山浄水場取水ポンプ更新工事		
施工場所	津市 芸濃町北神山 地内		
図 名	第 2 取水井取水ポンプ据付図		
縮 尺	1/75	図面番号	3/5
津市上下水道事業局			

※本図は参考図であり施工現場と本図に相違がある場合にあっては相違箇所を再調査後、市監督員と協議のうえ詳細を決定すること。

Technical drawing of a vertical pipe system, likely a sewer or drainage pipe, showing a cross-section and elevation. The drawing includes the following annotations and dimensions:

- Overall Dimensions:**
 - Width: 4400
 - Height: 8670
- Components and Replacement Work:**
 - 逆止弁 125A 今回更新 (Check valve 125A, replaced this time)
 - 2 F 曲管 125A 今回更新 (2 F elbow pipe 125A, replaced this time)
 - 2 F 直管 125A 今回更新 (2 F straight pipe 125A, replaced this time)
 - 2 F 異径直管 125A×100A 今回更新 (2 F异径 straight pipe 125A×100A, replaced this time)
 - 1号ポンプ 今回更新 (No. 1 pump, replaced this time)
- Elevations and Levels:**
 - +22.00 (Ground level)
 - ▽HML+20.70 (High Water Level)
 - ▽LWL+19.20 (Low Water Level)
 - +17.00 (Base level)
- Other Dimensions:**
 - 3500 (Vertical distance from ground to pump)
 - 2400 (Vertical distance from pump to base)
 - 140 (Vertical distance from base to pump)

Technical drawing of a pump room layout. The drawing shows a circular room with a diameter of 4400. Inside, there are two pumps labeled 1 and 2. The pumps are mounted on a platform. The distance between the centers of the pumps is 2200. The overall width of the pump area is 1200, and the height is 1400. The drawing includes various components and their dimensions:

- 逆止弁 125A 今回更新 (Check valve 125A, update this time)
- 2 F 曲管 125A 今回更新 (2 F elbow pipe 125A, update this time)
- 1号ポンプ台板 今回塗装 (Pump base plate No. 1, paint this time)
- 1号ポンプ 今回更新 (Pump No. 1, update this time)
- 接続点 (Connection point)
- ケーブル撤去・管挿入 今回更新 (Cable removal/pipe insertion, update this time)

Dimensions:



- Overall width: 4400
- Overall height: 1400
- Distance between pump centers: 2200
- Width of pump area: 1200

Other labels:

- 2号 (No. 2)
- 1号 (No. 1)
- A
- A'

工 事 名	令和 6 年度水施第 4 号 芸濃北神山浄水場取水ポンプ更新工事		
施工場所	津市 芸濃町北神山 地内		
図 名	第 3 取水井取水ポンプ据付図		
縮 尺	1/50	図面番号	4/5
津市上下水道事業局			

第 2 及び第 3 取水井 台板 参考図

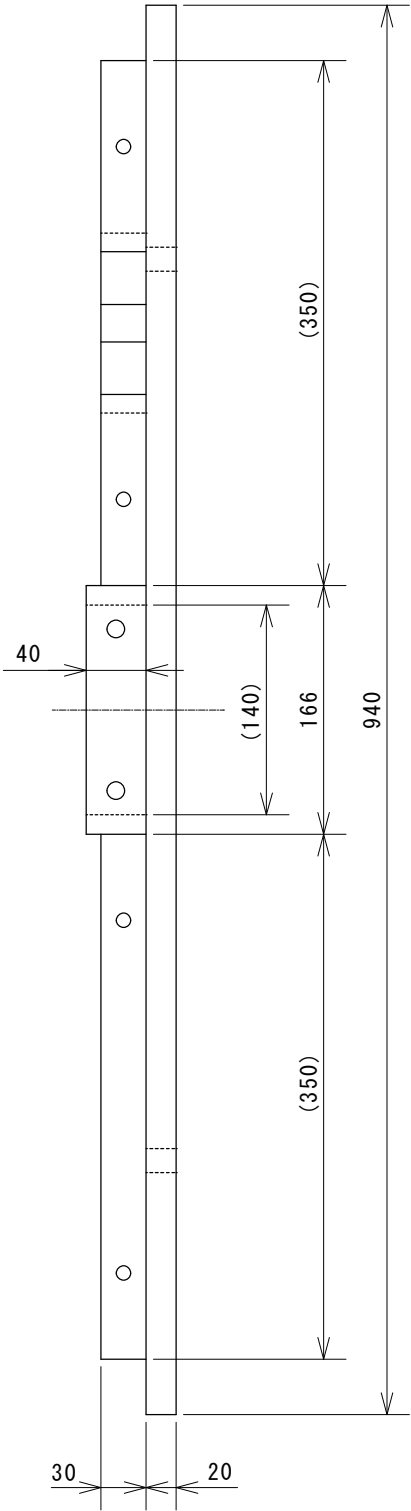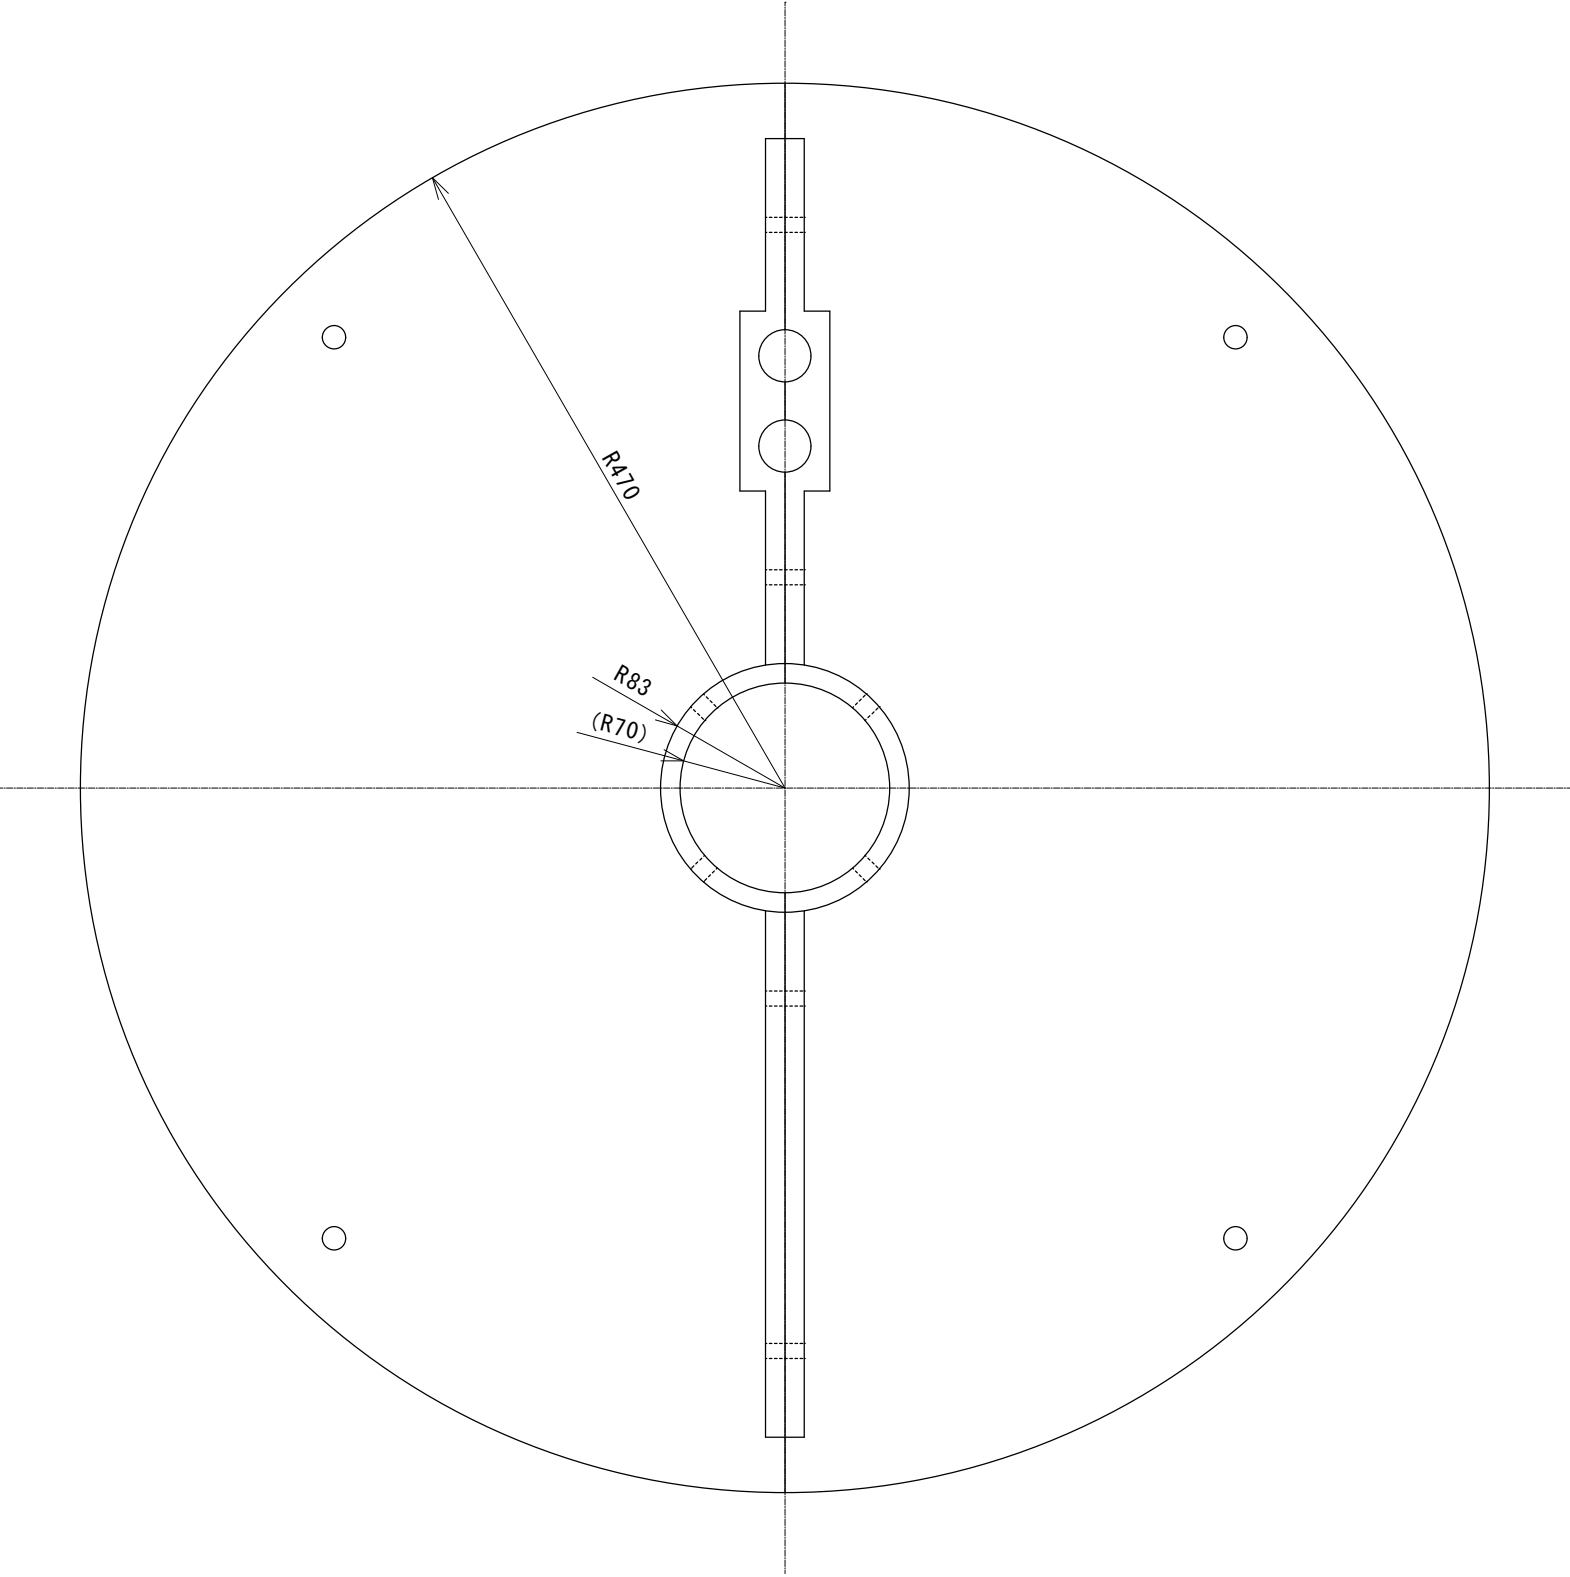

※本図は参考図であり施工現場と本図に相違がある場合にあつては相違箇所を再調査後、市監督員と協議のうえ詳細を決定すること。

原図：A 3

工 事 名	令和 6 年度水施第 4 号		
	芸濃北神山浄水場取水ポンプ更新工事		
施工場所	津市 芸濃町北神山 地内		
図 名	第 2 及び第 3 取水井 台板 参考図		
縮 尺	1/5	図面番号	5/5
	津市上下水道事業局		